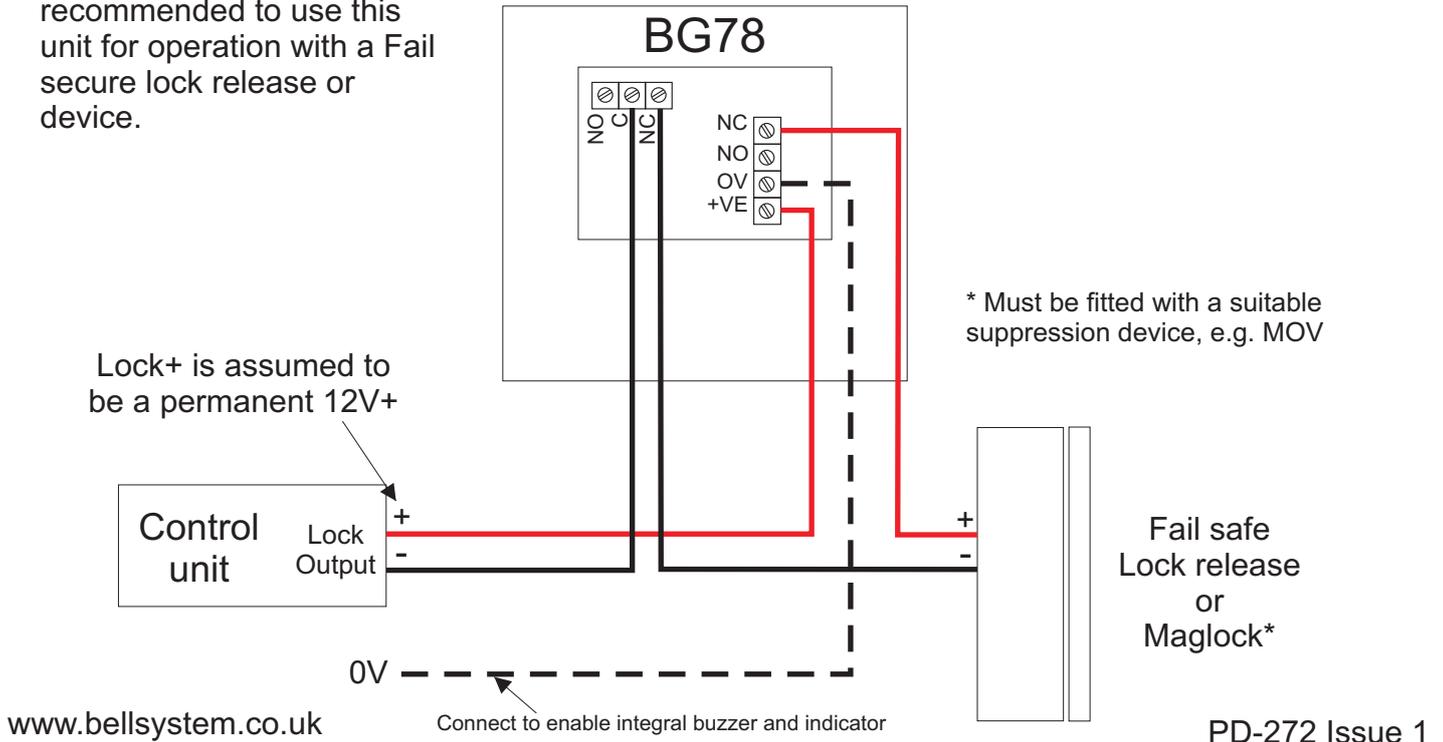# BG78 Emergency release button

**Important**
For safety reasons it is not recommended to use this unit for operation with a Fail secure lock release or device.

## Typical wiring

### BG78

NO
C
NC

NC
NO
0V
+VE

\* Must be fitted with a suitable suppression device, e.g. MOV

Lock+ is assumed to be a permanent 12V+

Control unit

Lock Output

+
-

+
-

Fail safe Lock release or Maglock\*

0V

www.bellsystem.co.uk

Connect to enable integral buzzer and indicator

PD-272 Issue 1

---

# BG78 Emergency release button

**Important**
For safety reasons it is not recommended to use this unit for operation with a Fail secure lock release or device.

## Typical wiring

### BG78

NO
C
NC

NC
NO
0V
+VE

\* Must be fitted with a suitable suppression device, e.g. MOV

Lock+ is assumed to be a permanent 12V+

Control unit

Lock Output

+
-

+
-

Fail safe Lock release or Maglock\*

0V

www.bellsystem.co.uk

Connect to enable integral buzzer and indicator

PD-272 Issue 1